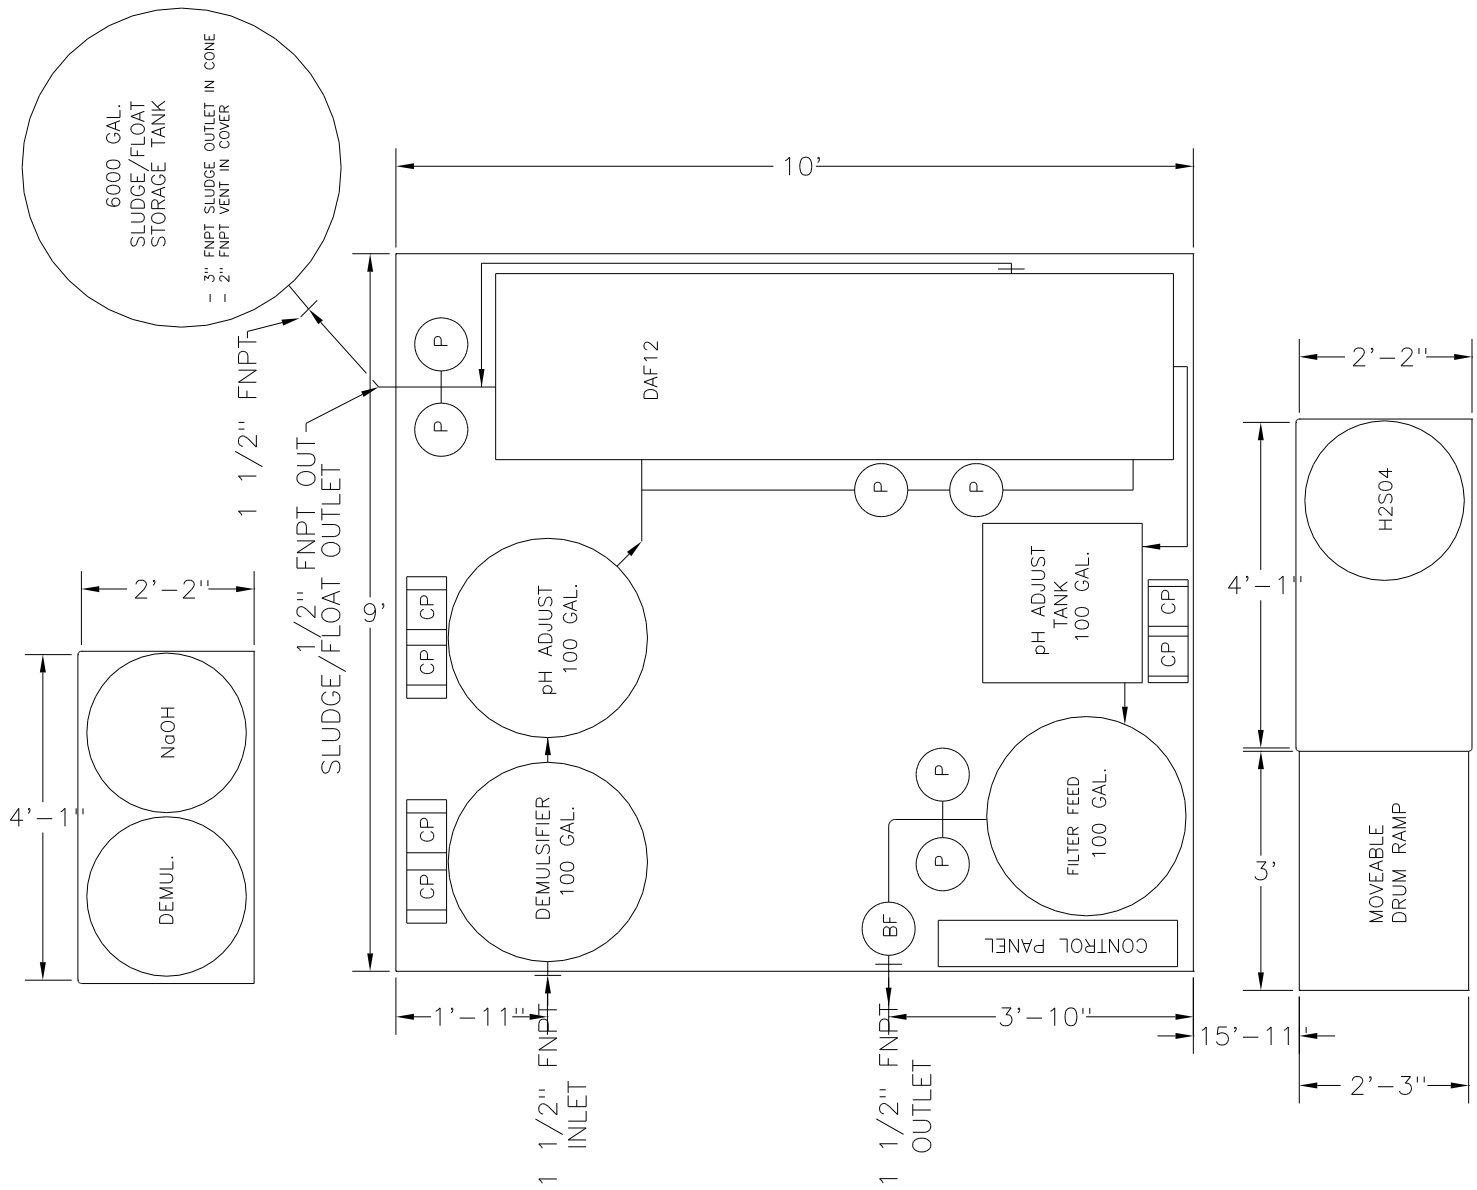

Make the skid mounted unit no wider than 8' such that it can be shipped without a wide load designation.

Switch the order of the demulsifier/pH adjustment and the pH final Adjustment/Filter feed on skid.

Add raw influent feed pumps to skid.

Show piping to 6,000 gallon tank and eliminate portions related to previously designated 500 gallon tank.

Note: 6,000 gallon tank not to scale. 7,000 gallon tank berm is to scale.

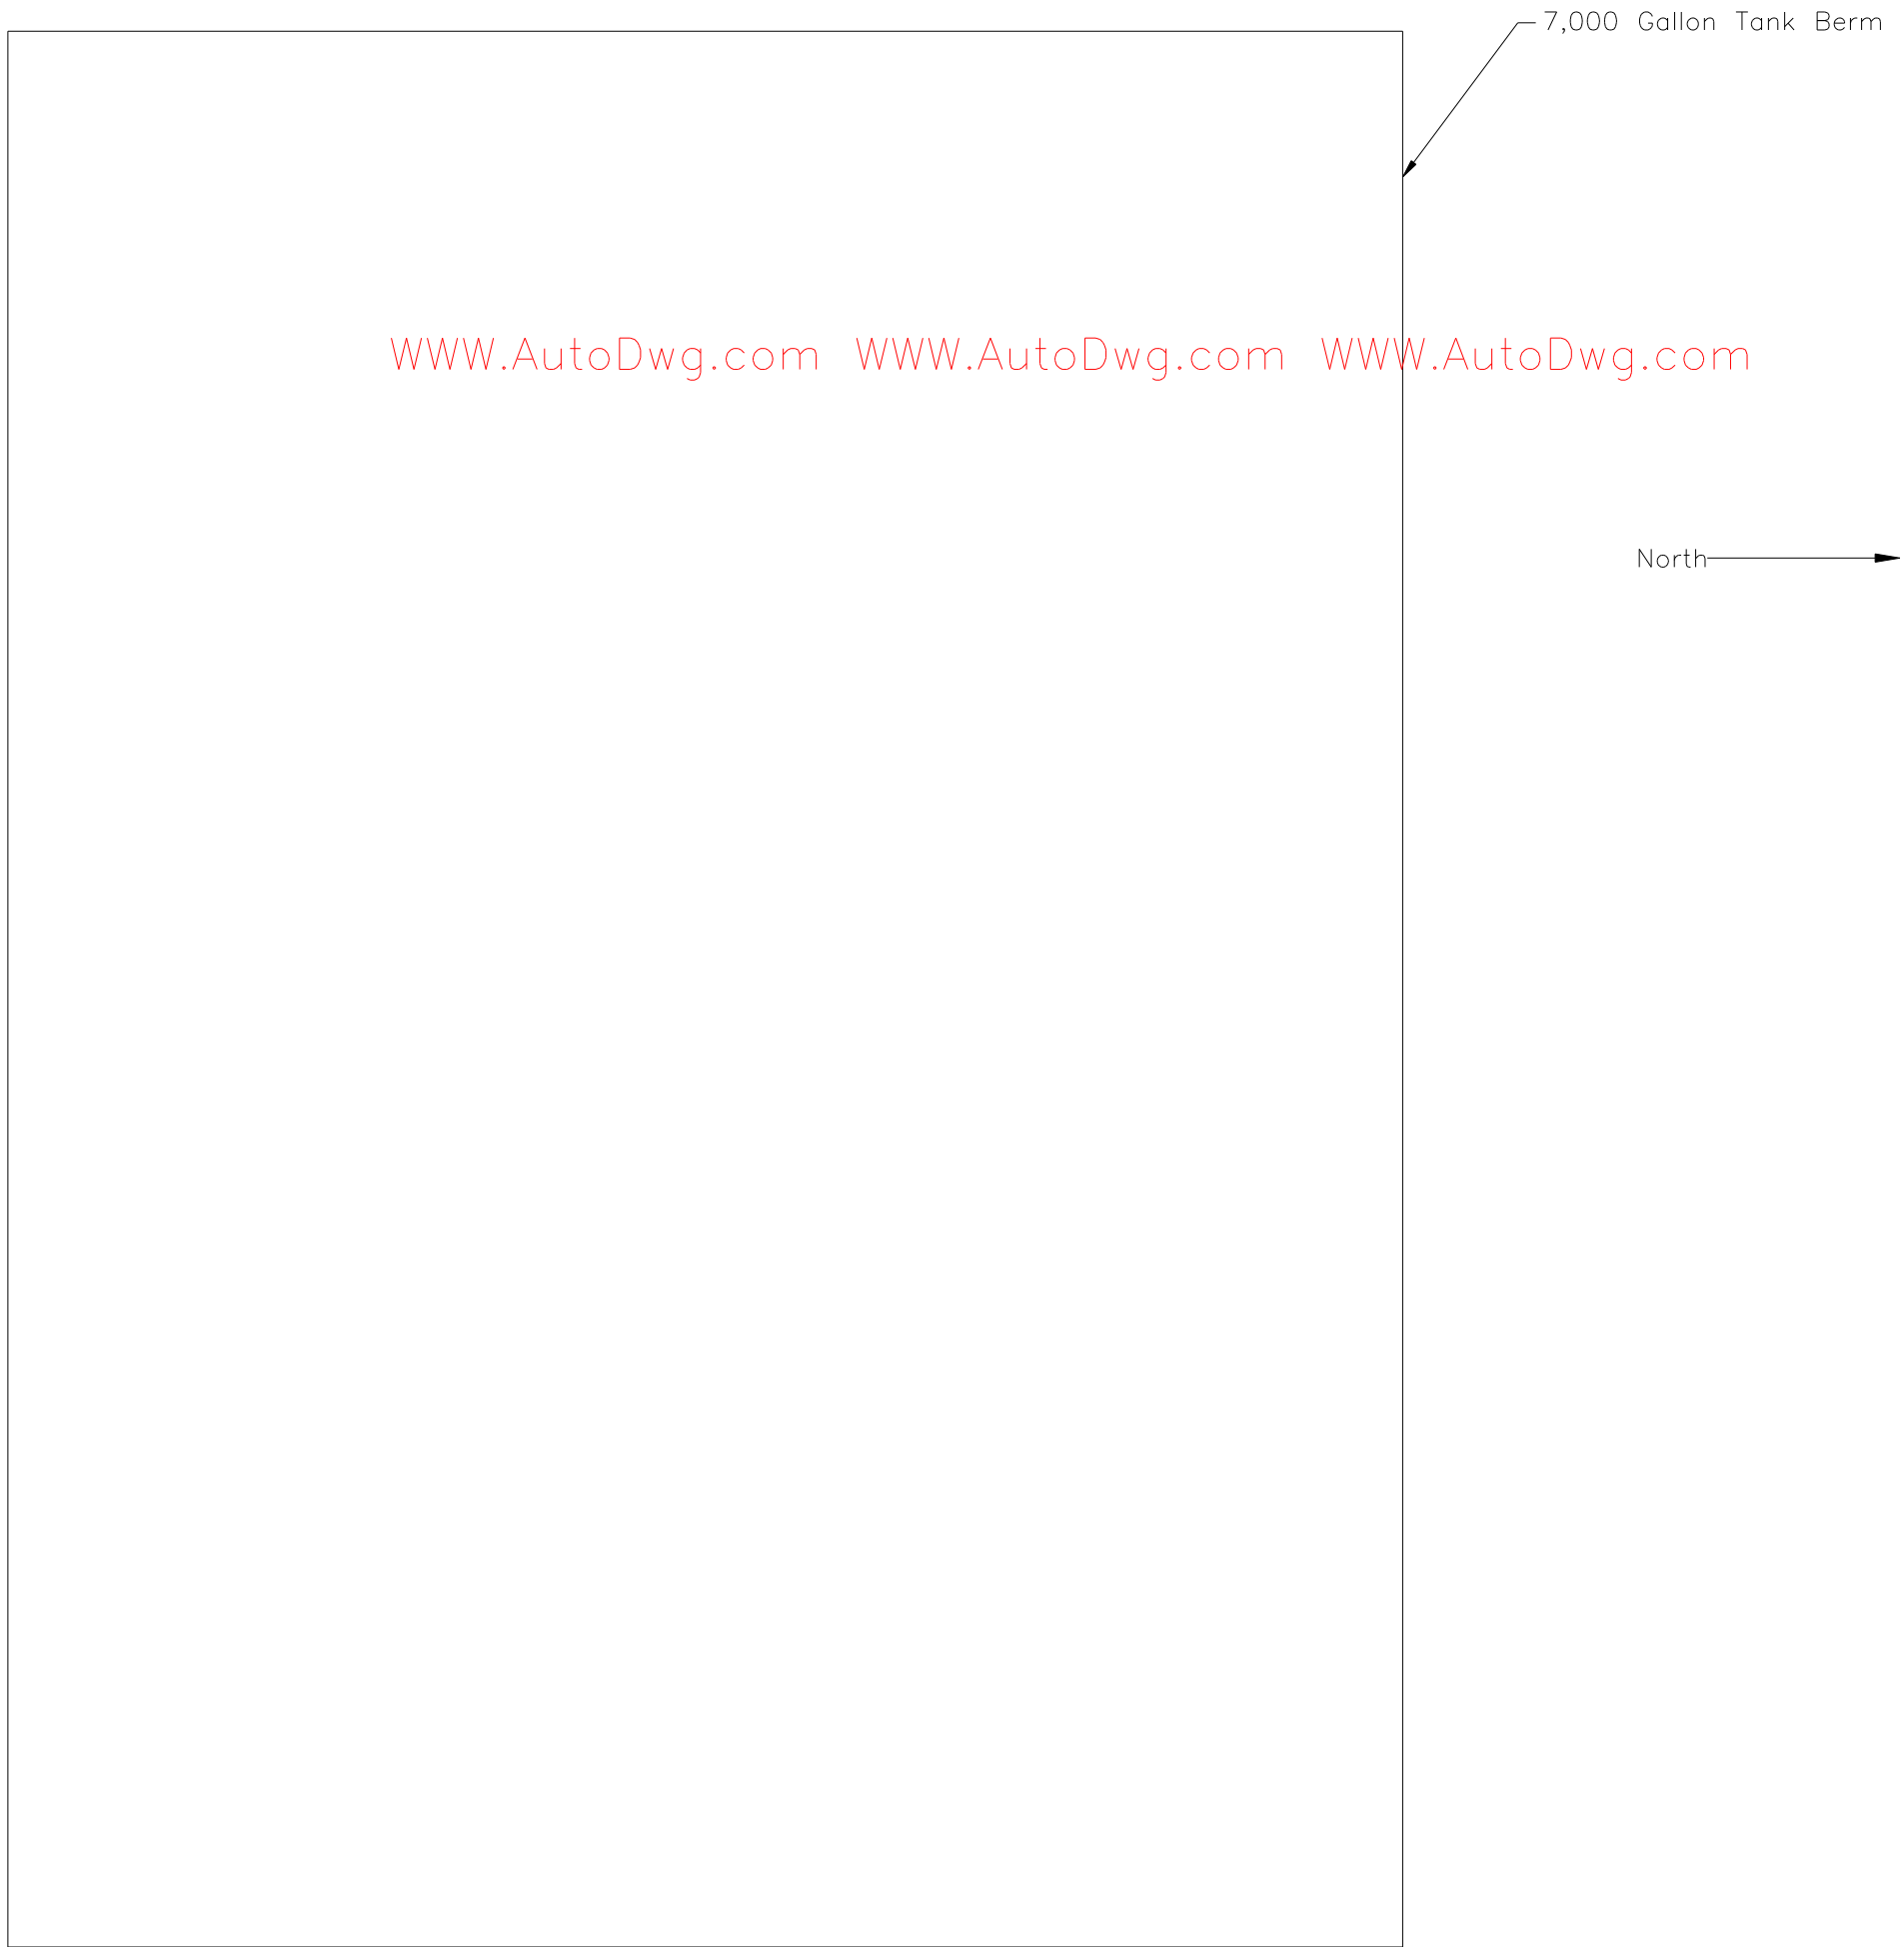

WWW.AutoDwg.com WWW.AutoDwg.com WWW.AutoDwg.com